



TEST REPORT

SCOPE OF WORK

SPC FLOORING

REPORT NUMBER

190514001SHF-009

TEST DATE(S)

2025-05-15 - 2025-06-05

ISSUE DATE

2025-06-05

PAGES


5

DOCUMENT CONTROL NUMBER

LFT-APAC-SHF-OP-10k(May 1, 2025)

©2025 INTERTEK

Intertek Testing Services Shenzhen Ltd. Shanghai Fengxian Branch

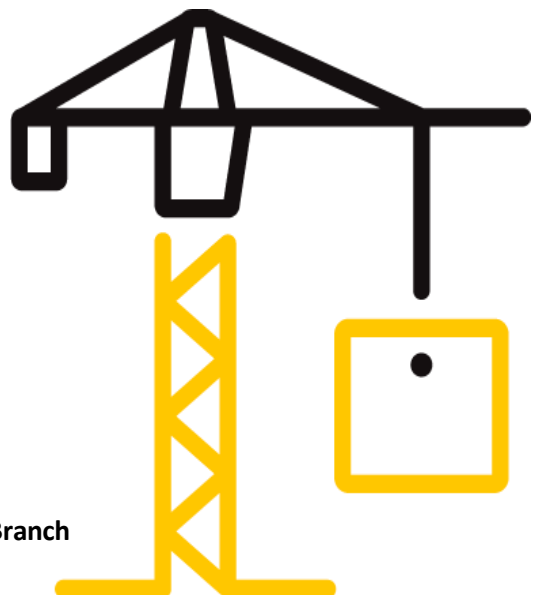

Test Report

Statement

1. This report is invalid without company's special seal for testing on assigned page.
2. This report is invalid without authorized person's signature.
3. This report is invalid where any unauthorized modification indicated.
4. Don't copy this report in partial (except full copy) without any official approval in written by our company. This report is invalid without re-stamping the special seal for testing in copying report.
5. Any holder of this document is advised that this report is for the exclusive use of Intertek's Customer and is provided pursuant to the agreement between Intertek and its Customer. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. This report was made with due care within the limitation of a defined scope of work and on the basis of information, materials and instructions received from the Customer or its nominated third parties. Intertek is under no obligation to refer to or report upon any facts or circumstances which are outside the specific instructions received and accepts no responsibility to any parties whatsoever, following the issue of the report, for any matters arising outside the agreed scope of the works. The tests results are not intended to be a recommendation for any particular course of action. Customer is responsible for acting as it sees fit on the basis of such results.
6. Intertek's written consent is required to use Intertek's name or logo on the object, product or service being tested. The observations and test results in this report relate only to the sample under test. This report alone does not indicate that the item, product or service has passed any Intertek certification program.

Test Report

Issue Date: 2025-06-05

Intertek Report No.

190514001SHF-009

Test Type :

Performance test, samples provided by the applicant.

Product Information

Product Name	SPC FLOORING	Brand	/
Sample Description	Good Condition	Sample Amount	13 pieces
		Received Date	2025-05-10
Sample ID	Model	Specification	
S190514001SHF.001	/	1530*230*5.5+1.5MM IXPE/0.55MM	


Test Methods And Standards

Test Standard	DIN 51130:2014
Specification Standard	/
Test Conclusion	The samples were tested according to the above standards, and the results are shown in the following page.

Note:

1.This report relates specifically to the sample(s) that were drawn and provided by the applicant or their nominated third party. The reported result(s) provide no warranty or verification on the sample(s) representing any specific goods and/or shipment and only relate to the sample(s) as received and tested.

Report Authorized


Flora Fan *Kyle Wang*
Name: Flora Fan Name: Kyle Wang
Title: Reviewer Title: Project Engineer

Test Report

Issue Date: 2025-06-05

Intertek Report No. 190514001SHF-009

Test Items, Method and Results:

Test item	Test Method	Test result
Slip resistance* (Oil-wet ramp test)	DIN 51130:2014	Angle: 15.4 ° Rating: R10

DIN 51130 Classification of Slip resistance (Oil-wet ramp test)

Classification	Angle
R9	$6^{\circ} < X \leq 10^{\circ}$
R10	$10^{\circ} < X \leq 19^{\circ}$
R11	$19^{\circ} < X \leq 27^{\circ}$
R12	$27^{\circ} < X \leq 35^{\circ}$
R13	$> 35^{\circ}$

Note:


- *Test item is not accredited by CMA, which is subcontracted on accreditation by CNAS L1401

Test Report


Issue Date: 2025-06-05

Intertek Report No. 190514001SHF-009

Appendix A: Sample Received Photo

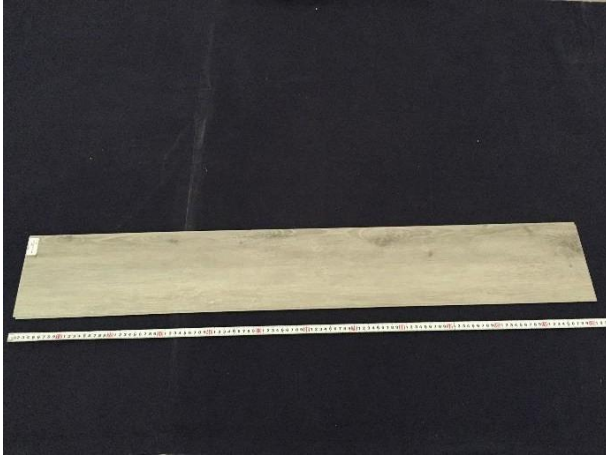

Front View (Test View)

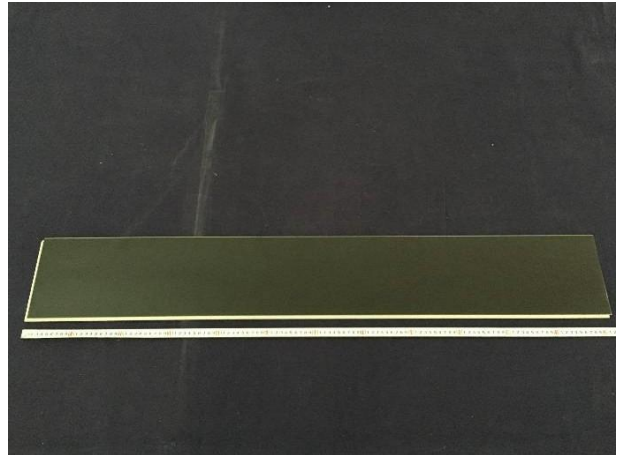

Back View

Revision:

NO.	Date	Changes	Author	Reviewer
190514001SHF-009	2025-06-05	First issue	Kyle Wang	Flora Fan